

# Analysis of the Lyapunov Stability of Grid Forming Converters Using Sum of Squares Optimization

Project Manager  
Siyuan Li

Principal Investigator  
Prof. Dr. Jutta Hanson


Project Term  
2024 - 2025

Clusters  
Lichtenberg II Cluster Darmstadt

Software  
MATLAB

Institute  
Institute of Electrical Energy Supply  
with Integration of Renewable Energy

University  
Technische Universität Darmstadt

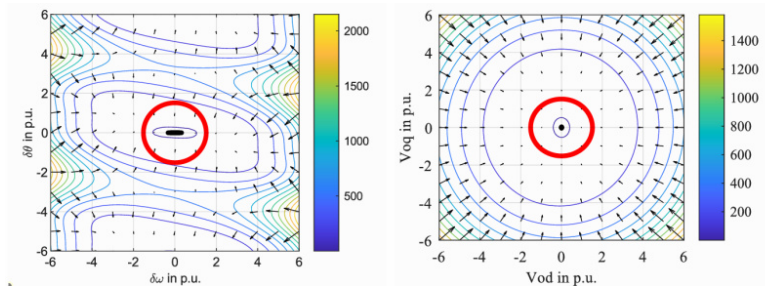

## Introduction

With the increasing integration of renewable energy sources, modern power systems are shifting from conventional networks dominated by large synchronous generators to the converter-dominated networks. This shift significantly reduces the inertia of the system which helps resist disturbances during the operation, and results in larger transients. To maintain stability in the converter-dominated, low-inertia systems, nonlinear analysis methods are required. One of such approaches is Lyapunov stability analysis, which can evaluate whether a system will return to equilibrium after being disturbed. However, applying this method to high-order systems involves high complexity numerical calculation and optimization problems that demand substantial computational power. This project leverages High-Performance Computing (HPC) to enable these demanding calculations. The study focuses on a simplified system consisting of a grid-forming converter connected to an external grid, aiming to determine its stability boundaries under various operating conditions and find the optimal parameters for the control system of the converter.

## Methods

This project consists of two phases, firstly calculation of the Region of Attraction (ROA). Using Sum of Squares (SOS) optimization, the Lyapunov function is derived to estimate the ROA. It describes a domain, from which the system states will in certain circumstances return to a stable operation point. Secondly, controller parameter optimization In the second phase, Particle Swarm Optimization (PSO) is employed to automatically tune the converter's control parameters. The algorithm iteratively searches for parameter combinations that maximize the ROA, using its projection size on specific space state plane as the optimization criterion.

## Results

Figure 1 illustrates the derived contour of the Lyapunov function of the grid-forming converter, projected onto two-dimensional planes to visualize its dynamic behaviour, which is calculated by the SOS optimization. Furthermore, the influence of the damping factor of the grid forming converter  $k_d$  on the ROA is investigated. The change of the stability region  $\beta$  and ROA  $c$  with the damping factor  $k_d$  are illustrated in Figure 2. Based on the Lyapunov stability analysis method, the PSO algorithm is implemented to search for the optimal controller parameters for the grid-forming converter. The results are shown in Figure 3, which is illustrated by the relationship between size of ROA and the time constants of converter controllers. After optimization, the voltage and current controller time constants are adjusted from  $T_{iv} = 22.21$  ms,  $T_{ic} = 31.83$  ms for the original parameters to  $T_{iv} = 32.77$  ms,  $T_{ic} = 5.42$  ms. This adjustment significantly improves the converter's dynamic response, and the ROA increased from 1.02 to 239.21.

## Discussion

The Lyapunov function in Figure 1 confirms that the system is asymptotically stable, aligning with conventional small-signal stability results. However, the computed ROA is conservative, underestimating the actual stability region. The analysis of the damping factor  $k_d$  in Figure 2 shows: as  $k_d$  changes, the ROA increases at first and decreases after a certain point, revealing a local optimum between  $k_d=1000$  and  $k_d=3110$ . After applying the tuning method, the time constant of the current controller is significantly reduced, suggesting a noticeable change in the current response to be observed in the simulation results. The size of ROA increases from 1.02 to 239.21, indicating a substantial improvement in stability performance under disturbances. Future work will explore hybrid optimization strategies that combine the global search capabilities of PSO with local refinement techniques, enabling faster convergence. Additionally, the approach will be extended to multi-objective problems, considering different types of disturbances and system configurations, including multi-converter and large-scale networks.

## Figures

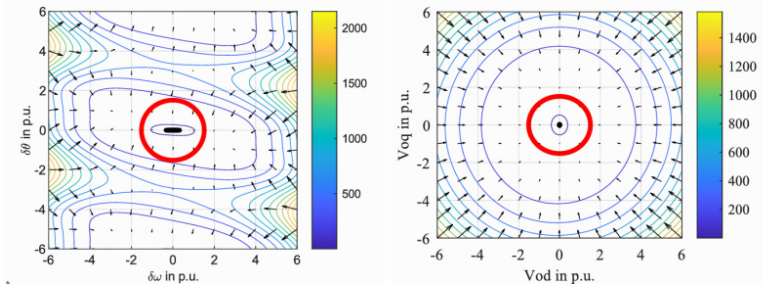


Figure 1: Contour of Lyapunov function (colour), the domain D (red), the ROA (black) and the gradients (arrows)

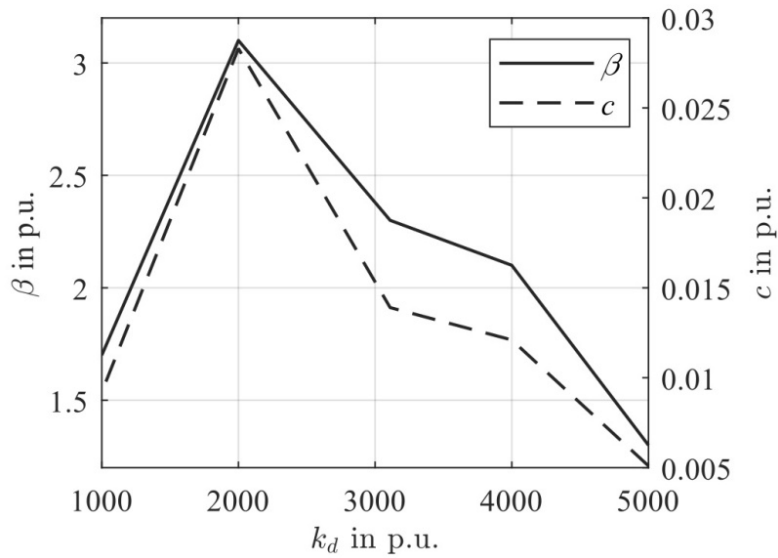


Figure 2: Comparison of the radius for domain D  $\beta$  (solid) and the value of ROA  $c$  (dash) with different parameter values of  $k_d$ .

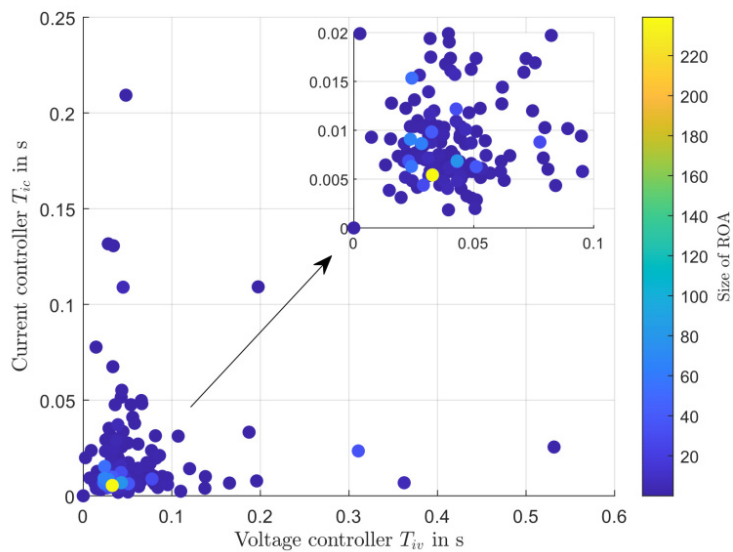


Figure 3: Size of ROA with respect to voltage and current controller parameters

## Publications

Li, S.; Xiao, X.; Hebing, A.; Jia, Y.; Choudhury, S.; Hanson, J.: " Lyapunov stability analysis of grid forming converters using sum of squares optimization"; In IET Conference Proceedings CP918 (Vol. 2025, No. 6, pp. 245-251) (2025) <https://doi.org/10.1049/icp.2025.1213>

*Last Update:* 2025-11-28 08:48